AOFILL.N
OVERFILL LIMITER VALVE

Applies to the following models **ONLY:**

AOFILL.N	AOFILL.N.3

Please read carefully **BEFORE** commencing installation.

Registered Office: HYTEK (GB) LIMITED,
Delta House, Green Street, Elsenham, Bishop's Stortford,
CM22 6DS UK.
Registered in England No. 1915382
Tel: +44 (0) 1279 815 600
Email: info@hytekgb.com

ENVIRONMENTAL INFORMATION

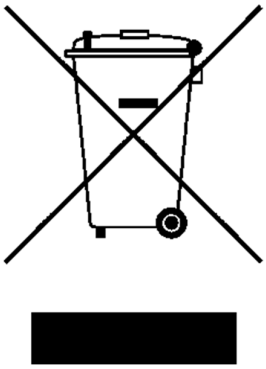

UK Regulation SI 2013 3113 requires that the equipment bearing this symbol on the product an/or its packaging must not be disposed of with unsorted municipal waste. The symbol indicates that this product must be disposed of separately from regular household waste streams. It is your responsibility to dispose of this and other electric and electronic equipment via designated collection facilities appointed by the government or local authorities.

IMPORTANT WARNING NOTES

1. This Hytek AOFILL overfill limiter valve is only intended for use on above ground fuel storage tanks.

2. This valve must only be used on tanks containing diesel or other liquids classed as category 3 in accordance with European Regulation No. 1272/2008. It must not be used on tanks containing petrol or any other liquid with a similar flash point.

3. Installation of this valve and its associated pipe-work should only be undertaken by qualified installation engineers.

4. Installation of this valve must conform to all relevant local authority standards and guidelines. When the fuel storage tank has been filled to its maximum capacity fuel will continue to flow through this valve at a minimal rate. An overfill will occur unless the fuel delivery is halted.

PARTS LIST

PART DESCRIPTION	PART NUMBER	
	AOFILL.N	**AOFILL.N.3**
Overfill Valve Body	AOF.BODY	AOF.3.BODY
Valve Sleeve	AOF.SLEEVE	AOF.3.SLEEVE
Brass Nut	AOF.NUT2	AOF.NUT3
Sealing Washer	LWASH.25F	LWASH.88
Float	AOF.FLOAT300	AOF.FLOAT300
Float Rod	AOF.ROD	AOF.ROD
Stainless Steel Pin 30mm Long	PIN.5.30SS	PIN.5.30SS
Stainless Steel Pin 50mm Long	PIN.5.50SS	PIN.5.50SS

HYTEK - *AOFILL.N OVERFILL LIMITER VALVE*

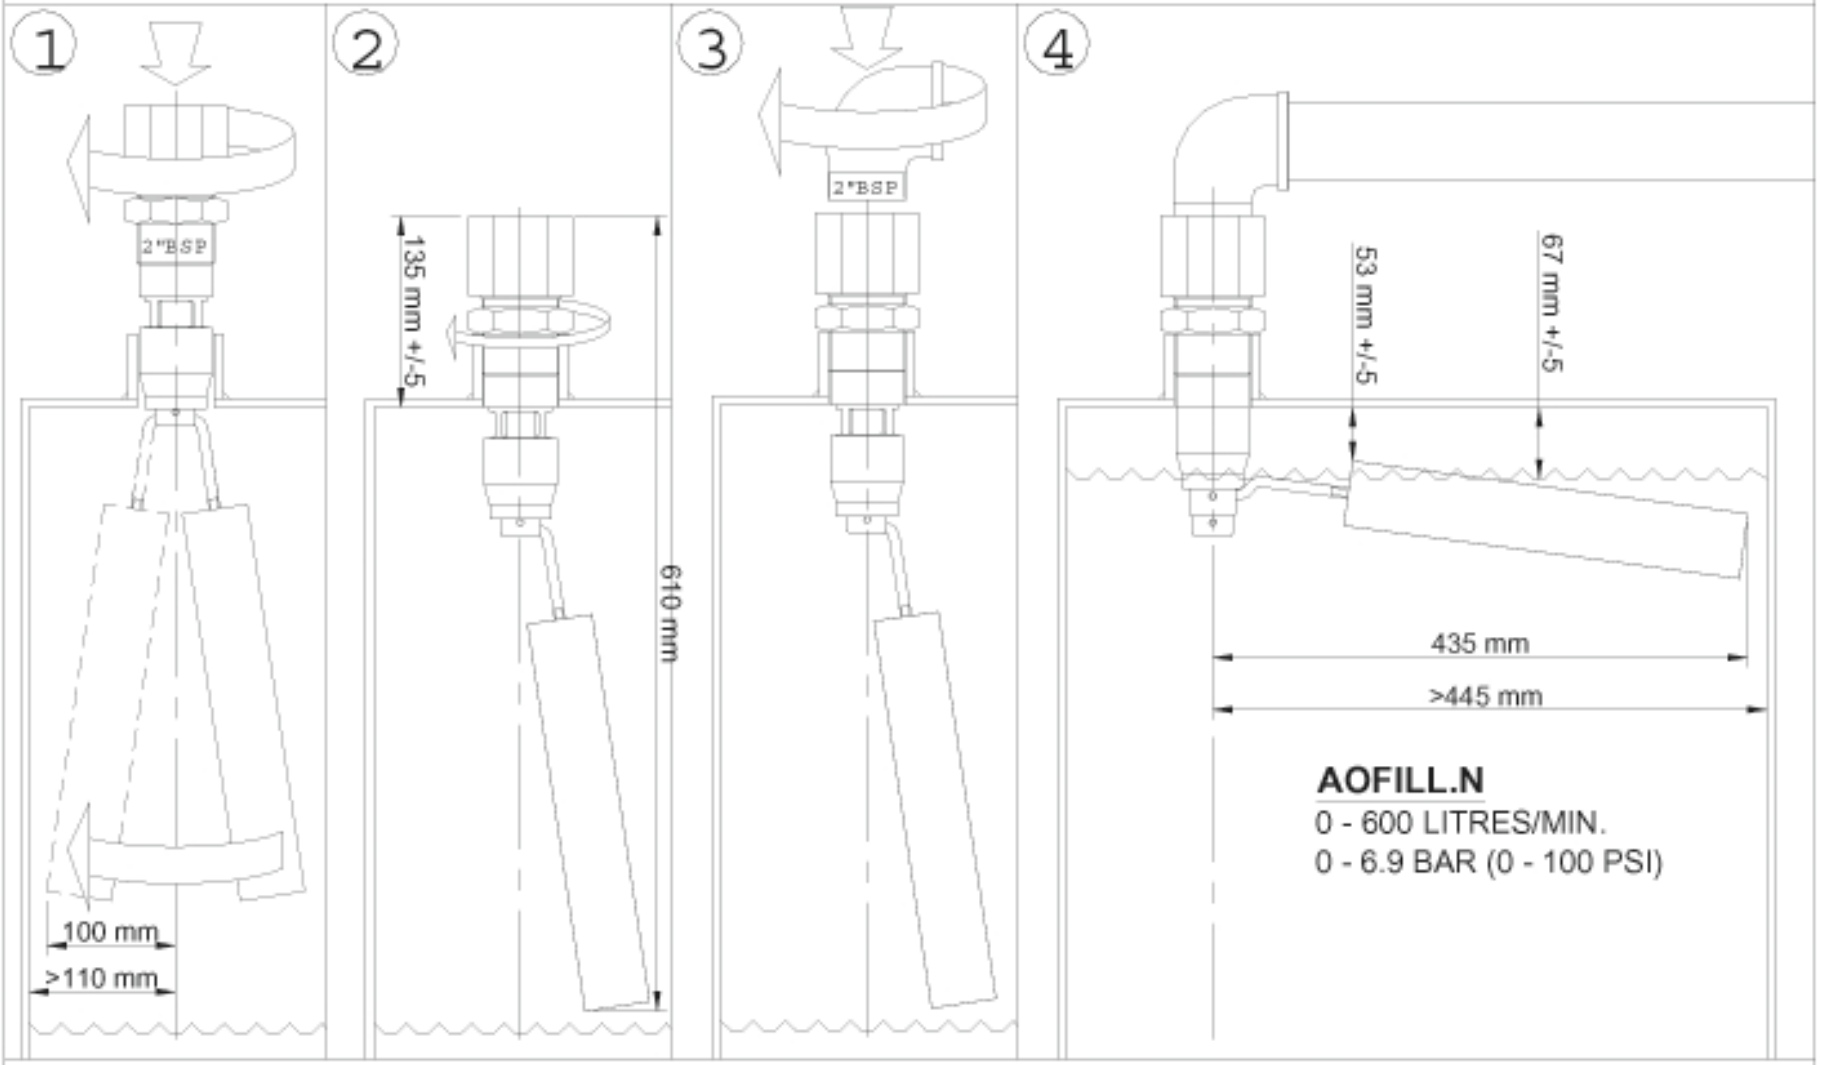

AOFILL.N

0 - 600 LITRES/MIN.

0 - 6.9 BAR (0 - 100 PSI)

WARNING

WHEN THE FUEL STORAGE TANK HAS BEEN FILLED TO MAXIMUM CAPACITY FUEL WILL CONTINUE TO FLOW THROUGH THE AOFILL.N AT A MINIMAL RATE. AN OVERFILL WILL OCCUR UNLESS THE FUEL DELIVERY IS HALTED.

S273/10

HYTEK - *AOFILL.N3 OVERFILL LIMITER VALVE*

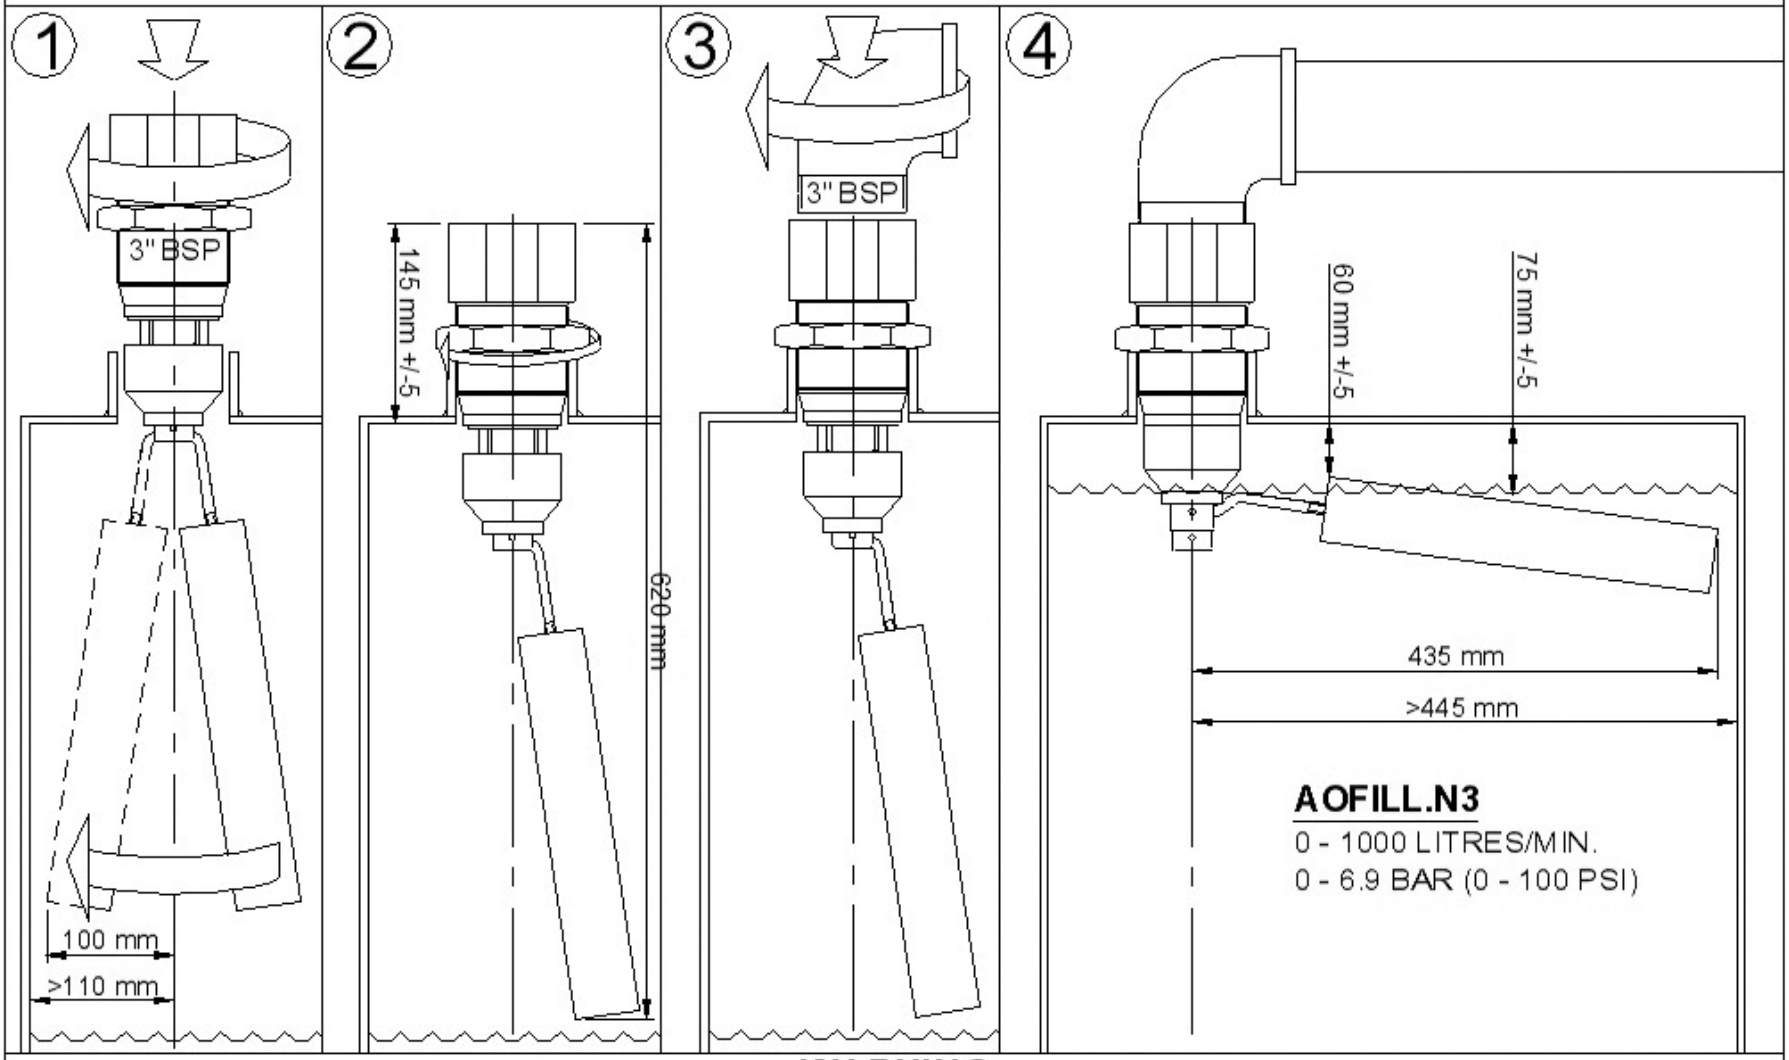

WARNING

WHEN THE FUEL STORAGE TANK HAS BEEN FILLED TO MAXIMUM CAPACITY FUEL WILL CONTINUE TO FLOW THROUGH THE AOFILL.N3 AT A MINIMAL RATE. AN OVERFILL WILL OCCUR UNLESS THE FUEL DELIVERY IS HALTED.

S273/10

DECLARATION OF CONFORMITY

Company Name: **Hytek (GB) Ltd**

Address: **Delta House**
Green Street
Elsenham
Bishops Stortford
Hertfordshire
CM22 6DS

Date of Issue: **24th April 2025**

Equipment Details: **AOFILL.N and AOFILL.N.3 Above Ground Overfill Limiter Valves**

Applicable Directives: Standards & Regulations

SI 2008 1597 Supply of Machinery Safety Regulations
2006/42/EC Machinery Directive

SI 2016 1105 Pressure Equipment Safety Regulations
2014/68/EU Pressure Equipment Directive

Declaration Number: **UK047 Issue 7**

On behalf of the above-named company, I declare under our sole responsibility that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives.

Clive Wellings

Clive Wellings, Processs Co-ordinator
24th April 2025
Bishop's Stortford, Herts

THE INFORMATION CONTAINED IN THIS DOCUMENT IS PROTECTED BY COPYRIGHT © AND PROPERTY LAWS AND IS THE SOLE PROPERTY OF HYTEK (GB) LTD. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF HYTEK (GB) LTD IS PROHIBITED.